


This information is intended only for general conceptual purposes. It is based on data and knowledge considered to be true and correct. It is offered for the user's consideration, investigation and verification and is not intended to substitute for the advice provided by appropriate professionals. Hydrotech assumes no liability for the use of this information. The determination of the suitability and applicability of this information is the sole responsibility of the user.

AMERICAN HYDROTECH, INC.

HYDROTECH

GARDEN ROOF ASSEMBLY

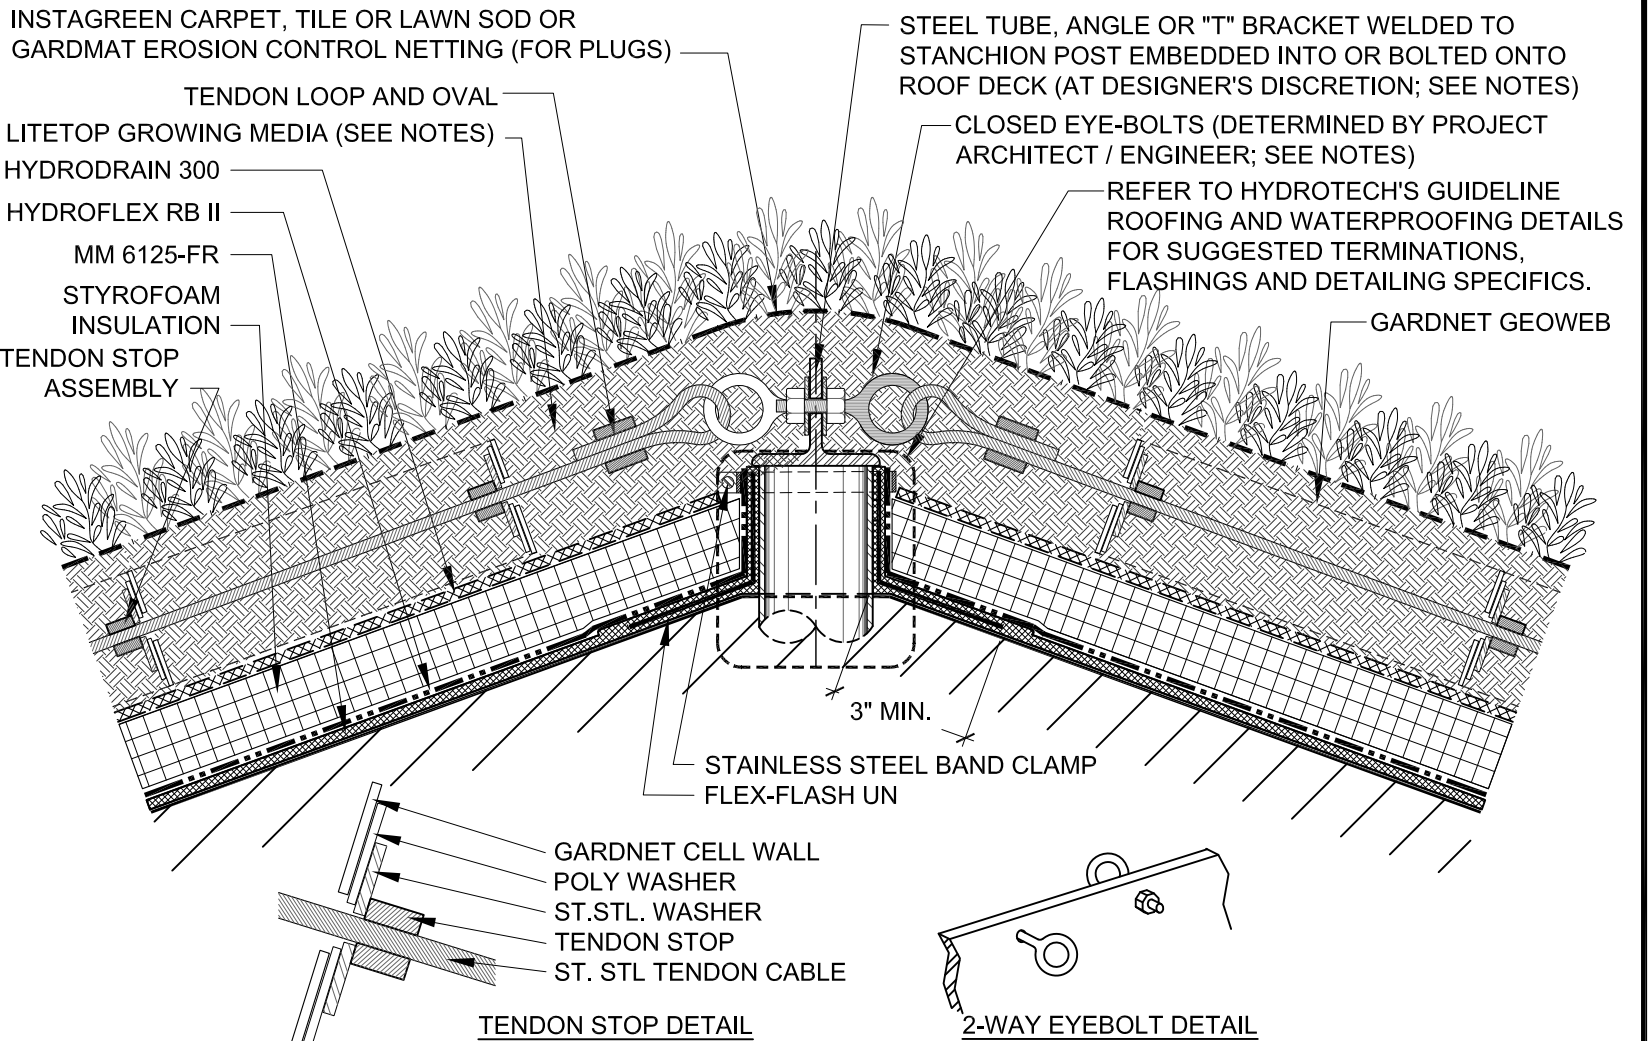

NOTES:

1. TOP OF SLOPE ATTACHMENT PULL-OUT STRENGTH AND METHOD OF ATTACHMENT MUST BE DETERMINED, DESIGNED AND VERIFIED BY PROJECT ARCHITECT / ENGINEER.
2. PRIOR TO SHIPPING GARDNET MATERIALS, PROJECT ARCHITECT / ENGINEER MUST PROVIDE HYDROTECH A SIGNED AND SEALED CONSTRUCTION DETAIL INDICATING GARDNET ATTACHMENT TO BUILDING STRUCTURE.
3. IF STYROFOAM INSULATION IS NOT INSTALLED, HYDRODRAIN 302 SHALL BE PLACED ON TOP OF THE HYDROFLEX RB II.
4. THE NUMBER OF STOPS AND THE SIZE, NUMBER, SPACING AND LENGTH OF REQUIRED TENDONS IS DETERMINED BY MEDIA DEPTH AND DEGREE AND LENGTH OF SLOPE.
5. LITETOP GROWING MEDIA MUST BE USED IN ALL GARDNET INSTALLATIONS. SUBSTITUTIONS ARE NOT ALLOWED.

GARDNET CONNECTION AT RIDGE WITH STANCHION AND BRACKET (WITH STYROFOAM INSULATION)

SCALE: NONE
DATE: 8/17/2020

GN-9